


VORTAC MFD	APP CRS	Rwy Idg	9001
108.8	130°	TDZE	1276
Chan 25		Apt Elev	1297

VOR RWY 14
MANSFIELD LAHM RGNL (MFD)

DME required. RADAR required for procedure entry.	MISSED APPROACH: Climb to 1700 then climbing left turn to 3000 on MFD VORTAC R-101 to READS/MFD 20.7 DME and hold.
---	--

ATIS 125.3	CLEVELAND APP CON ★ 128.35 360.65	MANSFIELD TOWER ★ 119.8 (CTAF) 291.775	GND CON 121.8 291.775	UNICOM 122.95
---------------	--------------------------------------	---	--------------------------	------------------

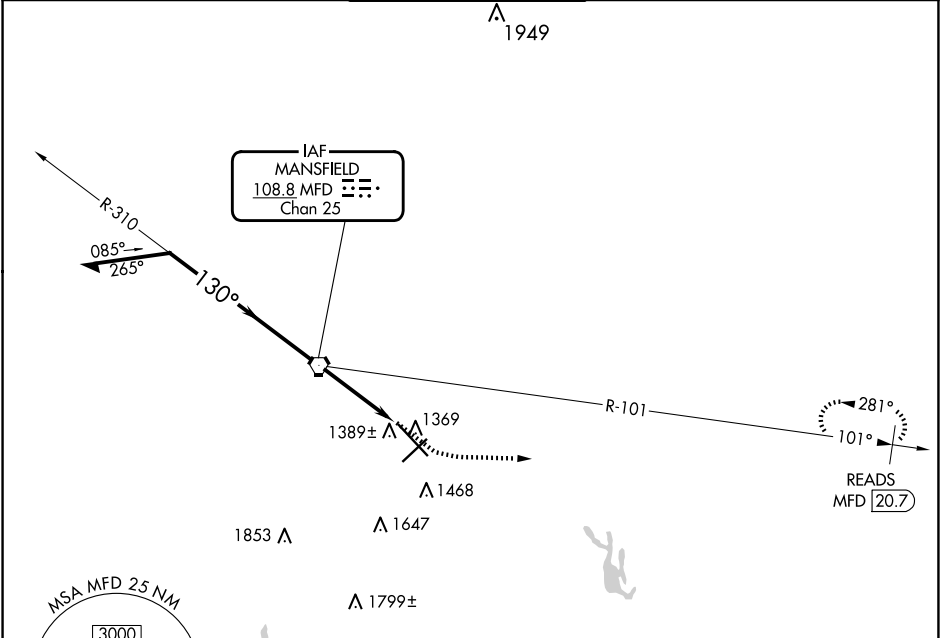

Remain within 10 NM	MFD VORTAC	1700	3000	READS
2900	310°	MFD R-101	MFD 20.7	
2500	130°	MFD 2.5	MFD 3.6	
VGSI and descent angles not coincident (VGSI Angle 3.00/ TCH 42).	3.21°	2.5 NM	1.1	
CATEGORY	A	B	C	D
S-14	1640-1	364 (400-1)		
CIRCLING	1760-1	463 (500-1)	2000-2 703 (800-2)	2000-2 1/4 703 (800-2 1/4)

ELEV 1297	D	TDZE 1276